Notice No. MRA:10122101.ajo

Public Notice Beginning Date: April 8, 2011

Public Notice Ending Date: May 9, 2011

National Pollutant Discharge Elimination System (NPDES)
Permit Program

PUBLIC NOTICE/FACT SHEET

of

Draft Reissued NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois EPA
Division of Water Pollution Control
Permit Section
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276
217/782-0610

Name and Address of Discharger:

Village of Hartford 140 W. Hawthorne Hartford, IL 62048 Name and Address of Facility: Village of Hartford CSO Outfall 103 Old St. Louis Road Hartford, Illinois (Madison County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES Permit to discharge into the waters of the state and has prepared a draft Permit and associated fact sheet for the above named discharger. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. All comments on the draft Permit and requests for hearing must be received by the IEPA by U.S. Mail, carrier mail or hand delivered by the Public Notice Ending Date. Interested persons are invited to submit written comments on the draft Permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the Permit applicant. The NPDES Permit and notice numbers must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft Permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicate a significant degree of public interest in the draft Permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final Permit is issued. For further information, please call Mark R. Ashrafi at 217/782-0610.

The following water quality and effluent standards and limitations were applied to the discharge:

Title 35: Environmental Protection, Subtitle C: Water Pollution, Chapter I: Pollution Control Board and the Clean Water Act were applied in determining the applicable standards, limitations and conditions contained in the draft Permit.

The applicant is engaged in treating domestic wastewater for the Village of Hartford CSO Outfall.

The length of the Permit is approximately 5 years.

The main discharge number is CSO A01. The seven day once in ten year low flow (7Q10) of the receiving stream, Mississippi River is 21620 cfs.

Dry weather flows, the first flush of storm events, and ten times average dry weather flow are normally pumped to the Wood River Regional Treatment Plant for complete treatment.

Public/Notice Fact Sheet – Page 2 – NPDES Permit No. IL0021423

Pursuant to the waiver provisions authorized by 40 CFR § 123.24, this draft permit is within the class, type, and size for which the Regional Administrator, Region V, has waived his right to review, object, or comment on this draft permit action.

Application is made for the reissued discharge(s) which is located in Madison County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

| ſ | Discharge | | | | Stream | Integrity |
|---|-----------|-------------------|-------------------|------------------|-----------------------|-----------|
| | Number | Receiving Stream | <u>Latitude</u> | <u>Longitude</u> | <u>Classification</u> | Rating |
| Ī | A01 | Mississippi River | 38° 50′ 00″ North | 90° 06′ 20″ West | General Use | * |

^{*} The Mississippi River is not listed as a biologically significant stream in the 2008 IDNR publication Integrating *Multiple Taxa* in a Biological Stream Rating System, nor is it given our integrity rating in that document.

To assist you further in identifying the location of the discharge(s) please see the attached map.

The stream segment(s) receiving the discharge from outfall(s) A01 is on the Illinois integrated Water Quality Report and Section 303 (d) List of impaired waters.

The following parameters have been identified as the pollutants causing impairment:

| Potential Causes | <u>Uses Impaired</u> |
|--|--|
| Polychlorinated biphenyls, and mercury (partially approved 2008 list only) | Fish consumption |
| Manganese Fecal coliform | Public and food processing Primary contact |

The discharge(s) from the facility is (are) proposed to be monitored and limited at all times as follows:

Discharge Number(s) and Name(s): CSO AO1 (West Hawthorne Road)


The effluent of the above discharge(s) shall be monitored and limited at all times as follows:

| | LOAD LIMITS lbs/day <u>DAF (DMF)*</u> | | | CC | | | |
|------------------|--|--------------------------|-------------------------|----------------------------------|--------------------------|-------------------------|----------------------------------|
| Parameter | Monthly <u>Average</u> | Weekly <u>Average</u> | Daily <u>Maximum</u> | Monthly <u>Average</u> | Weekly <u>Average</u> | Daily <u>Maximum</u> | Regulation |
| BOD ₅ | | | | Report | | Report | 35 IAC 304.120 40 CFR 133.102 |
| Suspended Solids | | | | Report | | Report | 35 IAC 304.120 40 CFR 133.102 |
| Fecal Coliform | | | | Report (as Geometric Mean) | | Report | 35 IAC 304.121 |

^{*}Load Limits are calculated by using the formula: 8.34 x (Design Average and/or Maximum Flow in MGD) x (Applicable Concentration in mg/L).

This draft Permit also contains the following requirements as special conditions:

- 1. CSO Requirements
- 2. Reopening of this Permit to include different final effluent limitations.
- 3. Submission of the operational data in a specified form and at a required frequency at any time during the effective term of this Permit.
- 4. Prohibition against causing or contributing to violations of water quality standards.
- 5. Recording the monitoring results on Discharge Monitoring Report Forms using one such form for each outfall each month and submitting the forms to IEPA each month.
- 6. Capacity, Management, Operations, and Maintenance (CMOM) requirements.
- 7. Bypass provisions of 40 CFR Section 122.41 (m) & (n).

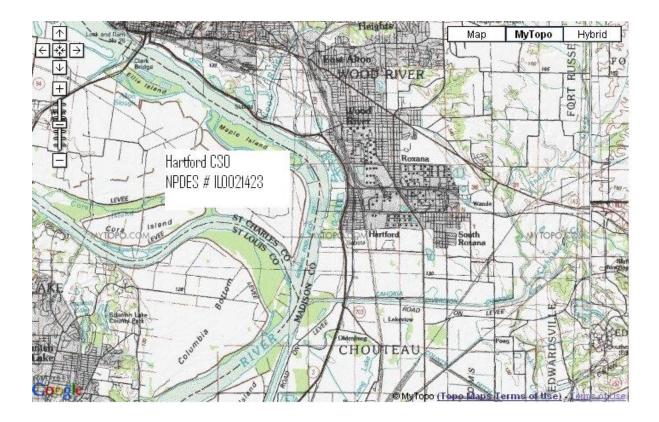

Illinois Environmental Protection Agency

Division of Water Pollution Control

1021 North Grand Avenue East

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Reissued (NPDES) Permit

Expiration Date: Issue Date: Effective Date:

Name and Address of Permittee:

Village of Hartford

140 W. Hawthorne

Hartford, IL 62048

Hartford, IL 62048

Facility Name and Address:

Village of Hartford CSO Outfall

103 Old St. Louis Road

Hartford, Illinois

(Madison County)

Receiving Waters: Mississippi River

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of the Ill. Adm. Code, Subtitle C, Chapter I, and the Clean Water Act (CWA), the above-named Permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the standard conditions and attachments herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the Permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Alan Keller, P.E. Manager, Permit Section Division of Water Pollution Control

SAK:MRA:10122101.ajo

Effluent Limitations, Monitoring, and Reporting

FINAL

Discharge Number(s) and Name(s): CSO AO1 (West Hawthorne Road)

Discharge from this outfall shall not occur until the Hartford Regional Pump Station is transporting its maximum practical flow.

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

| | LOAD LIMITS lbs/day <u>DAF (DMF)</u> | | | CONCENTRATION LIMITS mg/L | | | | |
|------------------|---|--------------------------|-------------------------|----------------------------------|--------------------------|--------------------------------|----------------------------|-----------------------|
| <u>Parameter</u> | Monthly <u>Average</u> | Weekly <u>Average</u> | Daily <u>Maximum</u> | Monthly <u>Average</u> | Weekly <u>Average</u> | <u>Daily</u> <u>Maximum</u> | Sample <u>Frequency</u> | Sample <u>Type</u> |
| Flow (MGD) | Report | | | | | | * | |
| Total Flow MG | | | Report | | | | | |
| BOD₅ | | | | Report | | Report | Daily When Discharging | Grab |
| Suspended Solids | | | | Report | | Report | Daily When Discharging | Grab |
| Fecal Coliform | | | | Report (as Geometric Mean) | | Report | Daily When Discharging | Grab |

Total flow in million gallons shall be reported on the Discharge Monitoring Report (DMR) in the quantity maximum column.

Flow in million gallons per day shall be reported on the DMR in the quantity monthly average column.

Report the number of days of discharge in the comments section of the DMR.

BOD₅ and Suspended Solids shall be reported on the Discharge Monitoring Report (DMR) as a concentration monthly average.

Fecal Coliform shall be reported on the DMRs as a Daily Maximum and as the Geometric Mean.

*Effluent flow measurement shall be continuous if hardware allows otherwise it may be a single reading daily when discharging.

SPECIAL CONDITION 1.

AUTHORIZATION OF COMBINED SEWER AND TREATMENT PLANT DISCHARGES

The IEPA has determined that at least a portion of the collection system consists of combined sewers. References to the collection system and the sewer system refer only to those parts of the system which are owned and operated by the Permittee unless otherwise indicated. The Permittee is authorized to discharge from the overflow(s)/bypass(es) listed below provided the diversion structure is located on a combined sewer and the following terms and conditions are met:

 Discharge Number
 Location
 Receiving Water

 A01
 West Hawthorne Road
 Mississippi River

Treatment Requirements

- 1. All combined sewer overflows and, if applicable, treatment plant bypasses, shall be given sufficient treatment to prevent pollution and the violation of applicable water quality standards and to the extent required by the federal Clean Water Act, including any amendments made by the Wet Weather Water Quality Act of 2000.
- 2. All dry weather flows to the extent required by PCB 85-33 and dated January 9, 1986 shall be transported to the city of Wood River Wastewater Treatment Works for treatment. The terms and conditions of this Board Order are hereby incorporated by reference as if fully set forth herein. All other flows shall be treated to the extent necessary to comply with applicable water quality standards and the Federal Clean Water Act, including the amendments pursuant to the Wet Weather Water Quality Act of 2000.
- 3. All CSO discharges authorized by this Permit shall be treated, in whole or in part, to the extent necessary to prevent accumulations of sludge deposits, floating debris and solids in accordance with 35 III. Adm. Code 302.203 and to prevent depression of oxygen levels below the applicable water quality standards.
- 4. Overflows during dry weather are prohibited. Dry weather overflows shall be reported to the IEPA pursuant to Standard Condition 12(e) of this Permit (24 hour notice).
- 5. The collection system shall be operated to optimize transport of wastewater flows and to minimize CSO discharges.

Nine Minimum Controls

- 6. The Permittee shall comply with the nine minimum controls contained in the National CSO Control Policy published in the Federal Register on April 19, 1994. The nine minimum controls are:
 - a. Proper operation and maintenance programs for the sewer system and the CSOs (Compliance with this Item shall be met through the requirements imposed by Paragraph 8 of this Special Condition);
 - b. Maximum use of the collection system for storage (Compliance with this Item shall be met through the requirements imposed by Paragraphs; 1, 2, 5, and 8 of this Special Condition);
 - c. Review and modification of pretreatment requirements to assure CSO impacts are minimized (Compliance with this Item shall be met through the requirements imposed by Paragraph 9 of this Special Condition);
 - d. Maximization of flow to the POTW for treatment (Compliance with this Item shall be met through the requirements imposed by Paragraphs 2, 5, and 8 of this Special Condition);
 - e. Prohibition of CSOs during dry weather (Compliance with this Item shall be met through the requirements imposed by Paragraph 4 of this Special Condition);
 - f. Control of solids and floatable materials in CSOs (Compliance with this Item shall be met through the requirements imposed by Paragraphs 3 and 8 of this Special Condition);
 - g. Pollution prevention programs which focus on source control activities (Compliance with this Item shall be met through the requirements imposed by Paragraph 6 of this Special Condition, See Below);

- h. Public notification to ensure that citizens receive adequate information regarding CSO occurrences and CSO impacts (Compliance with this Item shall be met through the requirements imposed by Paragraph 12 of this Special Condition); and,
- i. Monitoring to characterize impacts and efficiency of CSO controls (Compliance with this Item shall be met through the requirements imposed by Paragraphs 10 and 11 of this Special Condition).

A pollution prevention plan (PPP) was approved by the IEPA for this collection/treatment system on September 22, 1998. The pollution prevention plan shall be reviewed, and revised if necessary, by the Permittee to address the items contained in Chapter 8 of the U.S. EPA guidance document, Combined Sewer Overflows, Guidance For Nine Minimum Controls, and any items contained in previously-sent review documents from the IEPA concerning the PPP. Combined Sewer Overflows, Guidance For Nine Minimum Controls is available on line at http://www.epa.gov/npdes/pubs/owm0030.pdf. The PPP (or revised PPP) shall be presented to the general public at a public information meeting conducted by the Permittee within nine (9) months of the effective date of this Permit. The Permittee shall submit documentation that the pollution prevention plan complies with the requirements of this Permit and that the public information meeting was held. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Pollution Prevention Plan Certification" one (1) signatures. This certification form is available http://www.epa.state.il.us/water/permits/waste-water/forms/cso-pol-prev.pdf. Following the public meeting, the Permittee shall implement the pollution prevention plan within one (1) year and shall maintain a current pollution prevention plan, updated to reflect system modifications, on file at the sewage treatment works or other acceptable location and made available to the public. The pollution prevention plan revisions shall be submitted to the IEPA one (1) month from the revision date.

Sensitive Area Considerations

7. Pursuant to Section II.C.3 of the federal CSO Control Policy of 1994, sensitive areas are any water likely to be impacted by a CSO discharge which meet one or more of the following criteria: (1) designated as an Outstanding National Resource Water; (2) found to contain shellfish beds; (3) found to contain threatened or endangered aquatic species or their habitat; (4) used for primary contact recreation; or, (5) within the protection area for a drinking water intake structure.

Within one (1) month of the effective date of this Permit, the Permittee shall submit two (2) copies of documentation indicating which of the outfalls listed in this Special Condition do not discharge to sensitive areas. Such documentation shall include information regarding the use of the receiving water for primary contact activities (swimming, water skiing, etc.). If the Permittee believes that it is not possible for primary contact recreation to occur in the areas impacted or potentially impacted by the CSOs listed in this Special Condition, then justification as to why primary contact recreation is not possible shall be submitted. Adequate justification shall include, but is not limited to: (1) inadequate water depth; (2) presence of physical obstacles sufficient to prevent access to or for primary contact recreation; and, (3) uses of adjacent land sufficient to discourage primary contact activities. The IEPA will make a determination based on this documentation and other information available to the IEPA.

Should the IEPA conclude that any of the CSOs listed in this Special Condition discharge to a sensitive area, the IEPA will notify the Permittee in writing. Within three (3) months of the date of notification, or such other date contained in the notification letter, the Permittee shall submit two (2) copies of either a schedule to relocate, control, or treat discharges from these outfalls. If none of these options are possible, the Permittee shall submit adequate justification as to why these options are not possible. Such justification shall be in accordance with Section II.C.3 of the National CSO Control Policy.

Operational and Maintenance Plans

8. The IEPA reviewed and accepted a CSO operational and maintenance plan "CSO O&M plan" on July 8, 1999 prepared for this sewerage system. The Permittee shall review and revise, if needed, the CSO O&M plan to reflect system changes.

The CSO O&M plan shall be presented to the general public at a public information meeting conducted by the Permittee within nine (9) months of the effective date of this Permit. The Permittee shall submit documentation that the CSO O&M plan complies with the requirements of this Permit and that the public information meeting was held. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Operational Plan Checklist and Certification", one (1) with original signatures. Copies of the "CSO Operational Plan Checklist and Certification" are available online at http://www.epa.state.il.us/water/permits/waste-water/forms/cso-checklist.pdf. Following the public meeting, the Permittee shall implement the CSO O&M plan within one (1) year and shall maintain a current CSO O&M plan, updated to reflect system modifications, on file at the sewage treatment works or other acceptable location and made available to the public. The CSO O&M plan shall be submitted to the IEPA eight (8) months from the effective dat of this permit and CSO O&M plan revisions shall be submitted to the IEPA one (1) month from the revision date.

The objectives of the CSO O&M plan are to reduce the total loading of pollutants and floatables entering the receiving stream and to ensure that the Permittee ultimately achieves compliance with water quality standards. These plans, tailored to the local government's collection and waste treatment systems, shall include mechanisms and specific procedures where applicable to ensure:

- Collection system inspection on a scheduled basis;
- b. Sewer, catch basin, and regulator cleaning and maintenance on a scheduled basis;
- c. Inspections are made and preventive maintenance is performed on all pump/lift stations;
- d. Collection system replacement, where necessary;
- e. Detection and elimination of illegal connections;
- f. Detection, prevention, and elimination of dry weather overflows;
- g. The collection system is operated to maximize storage capacity and the combined sewer portions of the collection system are operated to delay storm entry into the system; and,
- The treatment and collection systems are operated to maximize treatment.

Sewer Use Ordinances

- 9. The Permittee, within six (6) months of the effective date of this Permit, shall review and where necessary, modify its existing sewer use ordinance to ensure it contains provisions addressing the conditions below. If no ordinance exists, such ordinance shall be developed and implemented within six (6) months from the effective date of this Permit. Upon completion of the review of the sewer use ordinance(s), the Permittee shall submit two (2) copies of a completed "Certification of Sewer Use Ordinance Review", one (1) with original signatures. Copies of the certification form can be obtained on line at http://www.epa.state.il.us/water/permits/waste-water/forms/sewer-use.pdf. The Permittee shall submit copies of the sewer use ordinance(s) to the IEPA upon written request. Sewer use ordinances are to contain specific provisions to:
 - a. Prohibit introduction of new inflow sources to the sanitary sewer system;
 - b. Require that new construction tributary to the combined sewer system be designed to minimize and/or delay inflow contribution to the combined sewer system;
 - c. Require that inflow sources on the combined sewer system be connected to a storm sewer, within a reasonable period of time, if a storm sewer becomes available:
 - d. Provide that any new building domestic waste connection shall be distinct from the building inflow connection, to facilitate disconnection if a storm sewer becomes available;
 - e. Assure that CSO impacts from non-domestic sources are minimized by determining which non-domestic discharges, if any, are tributary to CSOs and reviewing, and, if necessary, modifying the sewer use ordinance to control pollutants in these discharges; and,
 - f. Assure that the owners of all publicly owned systems with combined sewers tributary to the Permittee's collection system have procedures in place adequate to ensure that the objectives, mechanisms, and specific procedures given in Paragraph 8 of this Special Condition are achieved.

The Permittee shall enforce the applicable sewer use ordinances.

Long-Term Control Planning and Compliance with Water Quality Standards

10. A. Pursuant to Section 301 of the federal Clean Water Act, 33 U.S.C. § 1311 and 40 CFR § 122.4, discharges from the CSOs, including the outfalls listed in this Special Condition and any other outfall listed as a "Treated Combined Sewage Outfall", shall not cause or contribute to violations of applicable water quality standards or cause use impairment in the receiving waters. In addition, discharges from CSOs shall comply with all applicable parts of 35 III. Adm. Code 306.305(a), (b), (c), and (d).

- B. The Permittee shall develop a Long-Term CSO Control Plan (LTCP) for assuring that the discharges from the CSOs (treated or untreated) authorized in this Permit comply with Paragraph 10.a above and all applicable standards, including water quality standards. Two (2) copies of the LTCP shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit. The LTCP shall contain all applicable elements of Paragraph 10.c below including a schedule for implementation and provisions for re-evaluating compliance with applicable standards and regulations after implementation. The LTCP shall be:
 - 1. Consistent with Section II.C.4.a.i of the Policy; or,
 - Consistent with either Section II.C.4.a.ii, Section II.C.4.a.iii, or Section II.C.4.b of the Policy and be
 accompanied by data sufficient to demonstrate that the LTCP, when completely implemented, will be sufficient
 to meet water quality standards.
- C. Pursuant to the Policy, the required components of the LTCP include the following:
 - Characterization, monitoring, and modeling of the Combined Sewer System (CSS);
 - Consideration of Sensitive Areas;
 - Evaluation of alternatives;
 - 4. Cost/Performance considerations;
 - 5. Revised CSO Operational Plan;
 - 6. Maximizing treatment at the treatment plant;
 - 7. Implementation schedule;
 - 8. Post-Construction compliance monitoring program; and
 - 9. Public participation.

Following submittal of the LTCP, the Permittee shall respond to any initial IEPA review letter in writing within ninety (90) days of the date of such a review letter, and within thirty (30) days of any subsequent review letter(s), if any. Implementation of the LTCP shall be as indicated by IEPA in writing or other enforceable mechanism.

Monitoring, Reporting and Notification Requirements

11. The Permittee shall monitor the frequency of discharge (number of discharges per month) and estimate the duration (in hours) of each discharge from each outfall listed in this Special Condition. Estimates of storm duration and total rainfall shall be provided for each storm event.

For frequency reporting, all discharges from the same storm, or occurring within 24 hours, shall be reported as one. The date that a discharge commences shall be recorded for each outfall. Reports shall be in the form specified by the IEPA and on forms provided by the IEPA. These forms shall be submitted to the IEPA monthly with the DMRs and covering the same reporting period as the DMRs. Parameters (other than flow frequency), if required in this Permit, shall be sampled and reported as indicated in the transmittal letter for such report forms.

- 12. A public notification program in accordance with Section II.B.8 of the federal CSO Control Policy of 1994 shall be developed employing a process that actively informs the affected public. The program shall include at a minimum public notification of CSO occurrences and CSO impacts, with consideration given to including mass media and/or Internet notification. The Permittee shall also consider posting signs in waters likely to be impacted by CSO discharges at the point of discharge and at points where these waters are used for primary contact recreation. Provisions shall be made to include modifications of the program when necessary and notification to any additional member of the affected public. The program shall be presented to the general public at a public information meeting conducted by the Permittee. The Permittee shall conduct the public information meeting within nine (9) months of the effective date of this Permit. The Permittee shall submit documentation that the public information meeting was held, shall submit a summary of all significant issues raised by the public and the Permittee's response to each issue and shall identify any modifications to the program as a result of the public information meeting. The Permittee shall submit the public information meeting documentation to the IEPA and implement the public notification program within twelve (12) months of the effective date of this Permit. The Permittee shall submit copies of the public notification program to the IEPA upon written request.
- 13. If any of the CSO discharge points listed in this Special Condition are eliminated, or if additional CSO discharge points, not listed in this Special Condition, are discovered, the Permittee shall notify the IEPA in writing within one (1) month of the respective outfall elimination or discovery. Such notification shall be in the form of a request for the appropriate modification of this NPDES Permit.

Summary of Compliance Dates in this CSO Special Condition

14. The following summarizes the dates that submittals contained in this Special Condition are due at the IEPA (unless otherwise indicated):

Submission of CSO Monitoring Data (Paragraph 11)

25th of every month

Submission of Revised CSO O&M Plan (Paragraph 8)

1 month from revision date

Documentation of CSO Locations (Paragraph 7, Sensitive Areas)

1 month from the effective date of this Permit.

Elimination of a CSO or Discovery of Additional CSO

Locations (Paragraph 13)

1 month from discovery or elimination

Control (or Justification for No Control) of CSOs to

Sensitive Areas (Paragraph 7)

3 months from IEPA notification

Certification of Sewer Use Ordinance Review (Paragraph 9)

6 months from the effective date of this Permit

Conduct Pollution Prevention, OMP, and PN Public Information

Meeting (Paragraphs, 6, 8 and 12) No Submittal Due with this Milestone 9 months from the effective date of this Permit

Submit Pollution Prevention Certification, OMP Certification, and PN Information Meeting Summary (Paragraphs, 6, 8 and 12)

12 months from the effective date of this Permit

Submit CSO Long-Term Control Plan (Paragraph 10)

12 months from the effective date of this Permit

All submittals listed in this Special Condition can be mailed to the following address:

Illinois Environmental Protection Agency Division of Water Pollution Control 1021 North Grand Avenue East Post Office Box 19276 Springfield, Illinois 62794-9276

Attention: CSO Coordinator, Compliance Assurance Section

All submittals hand carried shall be delivered to 1021 North Grand Avenue East.

Reopening and Modifying this Permit

The IEPA may initiate a modification for this Permit at any time to include requirements and compliance dates which have been 15. submitted in writing by the Permittee and approved by the IEPA, or other requirements and dates which are necessary to carry out the provisions of the Illinois Environmental Protection Act, the Clean Water Act, or regulations promulgated under those Acts. Public Notice of such modifications and opportunity for public hearing shall be provided.

SPECIAL CONDITION 2. This Permit may be modified to include different final effluent limitations or requirements which are consistent with applicable laws, regulations, or judicial orders. The IEPA will public notice the permit modification.

SPECIAL CONDITION 3. The IEPA may request in writing submittal of operational information in a specified form and at a required frequency at any time during the effective period of this permit.

Special Conditions

<u>SPECIAL CONDITION 4</u>. The effluent, alone or in combination with other sources, shall not cause or contribute to a violation of any applicable water quality standard outlined in 35 III. Adm. Code 302.

<u>SPECIAL CONDITION 5.</u> The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) Forms using one such form for each outfall each month.

In the event that an outfall does not discharge during a monthly reporting period, the DMR Form shall be submitted with no discharge indicated.

The Permittee may choose to submit electronic DMRs (eDMRs) instead of mailing paper DMRs to the IEPA. More information, including registration information for the eDMR program, can be obtained on the IEPA website, http://www.epa.state.il.us/water/edmr/index.html.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 25th day of the following month, unless otherwise specified by the permitting authority.

Permittees not using eDMRs shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency Division of Water Pollution Control Attention: Compliance Assurance Section, Mail Code # 19 1021 North Grand Avenue East Post Office Box 19276 Springfield, Illinois 62794-9276

<u>SPECIAL CONDITION 6</u>. The Permittee shall develop and submit to the IEPA a Capacity, Management, Operations, and Maintenance (CMOM) plan within twelve (12) months of the effective date of this Permit. The Permittee may be required to construct additional sewage transport and/or treatment facilities in future permits or other enforceable documents.

The CMOM plan shall include the following elements:

- A. Measures and Activities:
 - 1. A complete map of the collection system;
 - 2. Schedules, checklists, and mechanisms to ensure that preventative maintenance is performed on equipment;
 - 3. An assessment of the capacity of the collection and treatment system at critical junctions and immediately upstream of locations where overflows and backups occur or are likely to occur; and
 - 4. Identification and prioritization of structural deficiencies in the system.
- B. Design and Performance Provisions:
 - Monitor the effectiveness of CMOM;
 - 2. Upgrade the elements of the CMOM plan as necessary; and,
 - 3. Maintain a summary of CMOM activities.
- C. Overflow Response Plan:
 - 1. Know where overflows and backups occur; and,
 - 2. Respond to each overflow or backup to determine additional actions such as clean up.
- D. System Evaluation Plan.
- E. Reporting and Monitoring Requirements.
 - 1. Submission of annual CMOM report by January 15 of each year detailing the previous year's activities.

SPECIAL CONDITION 7. The provisions of 40 CFR Section 122.41 (m) & (n) are applicable and are hereby incorporated by reference.